



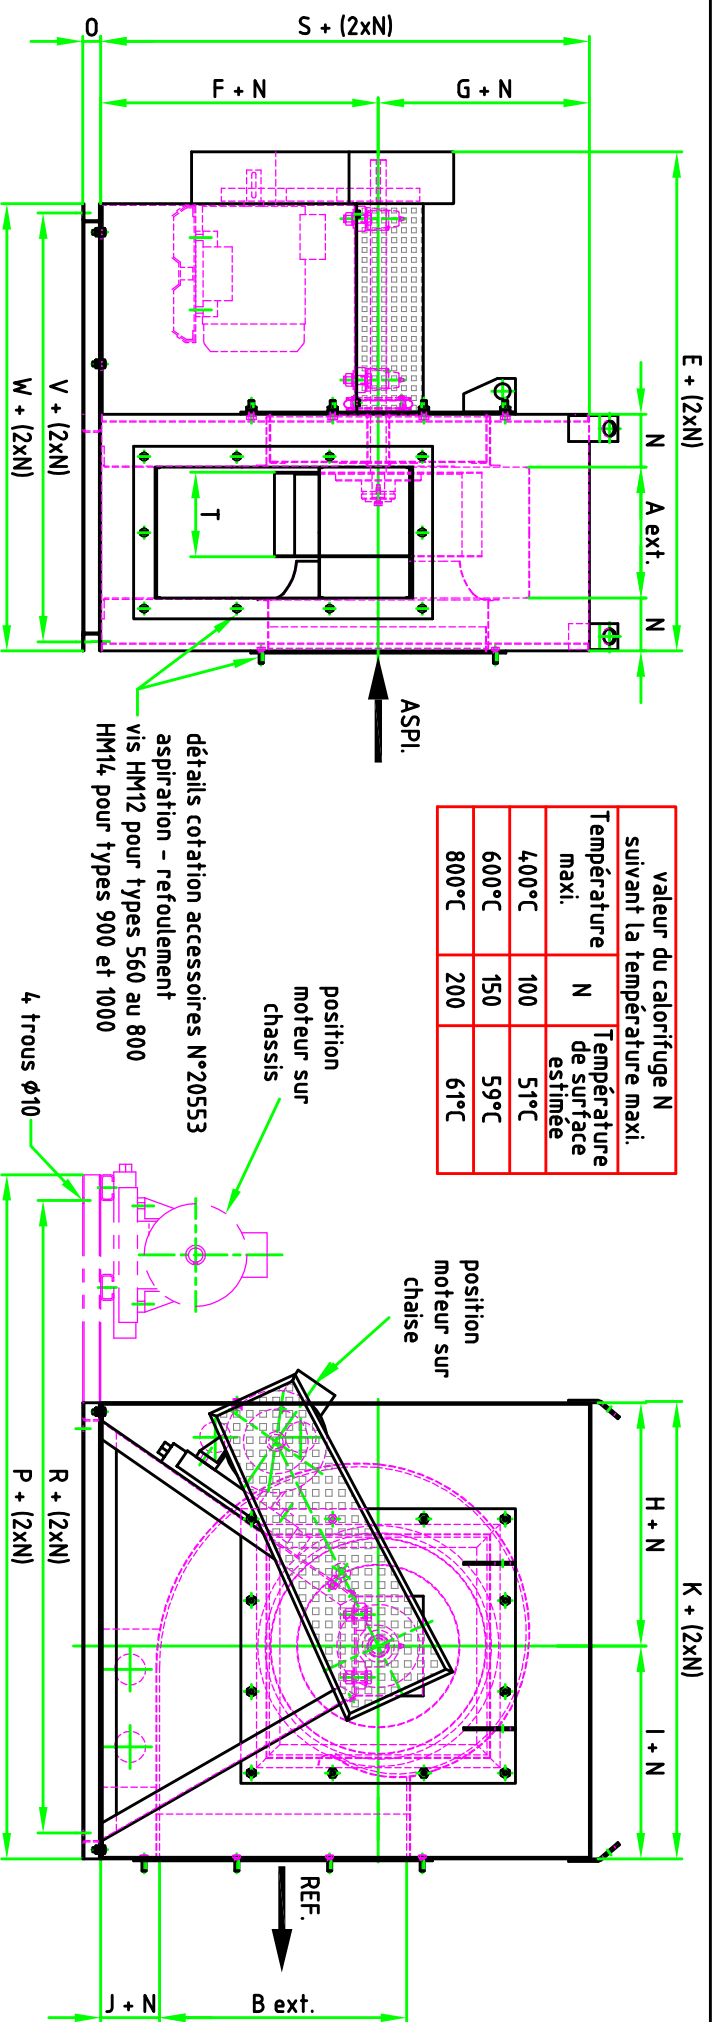

valeur du calorifuge N suivant la température maxi.		
Température maxi.	N	Température de surface estimée
400°C	100	51°C
600°C	150	59°C
800°C	200	61°C

Ventilateurs														chassis						moteur sur chaise				moteur sur chassis				H.A.
TYPE	T	A	B	E	F	G	H	I	J	K	S	O	V	W	P	R	P	R	P	R	P	R	P	R	P	R	moteur	maxi.
VP 560	255	403	710	1015	703	411	496	406	100	902	1114	70	845	885	1114	1074	902	862	1610	1410	1400	1200	160					
	290	438		1050									880	920														
VP 630	255	423	800	1200	779	463	559	451	100	1010	1242	70	1030	1070	1242	1202	1010	970	1740	1540	1510	1310						
	320	488		1265									1095	1135														
VP 710	290	469	900	1315	863	521	629	506	100	1135	1384	70	1145	1185	1384	1344	1135	1095	1880	1680	1640	1440						
	360	545		1385									1215	1255														
VP 800	320	516	1000	1390	960	586	706	562	100	1268	1546	100	1210	1260	1546	1496	1268	1218	2050	1850	1770	1570	180					
	405	603		1475									1295	1345														
VP 900	360	580	1120	1475	1089	661	797	627	120	1424	1750	100	1295	1345	1750	1700	1424	1374	2250	2050	1920	1720	200					
	405	628		1520									1340	1390														
VP 1000	405	644	1250	1605	1186	727	875	683	120	1558	1913	100	1425	1475	1913	1863	1558	1508	2410	2210	2060	1860						
	505	744		1705									1525	1575														

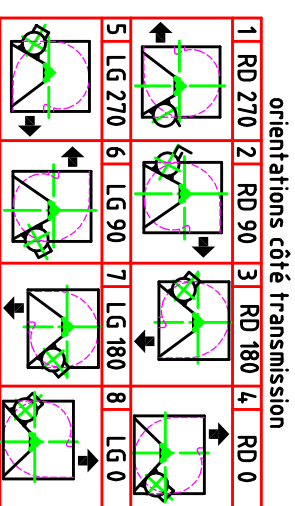

siège : 5-7 Av. Ferdinand buisson 75016 PARIS - Tél : 01.46.20.37.20 - Fax : 01.46.20.34.13 - Site : www.airap.fr - email : spariss@airap.fr

VENTILATEUR type VP SOC VAC HT° CALORIFUGE
SIMPLE OUÏE A L'ASPIRATION ENTRAÎNEMENT PAR COURROIES - TURBINE TURA Ø560 à 1000